


911 address shall be a minimum 3" lettering marked on meter enclosure, pole, or durable material attached to pole and should be visible from street. (See sections 1-3, 3, 4)

**Call 48 Hours Before You Dig**  
**1-888-258-0808**

In locations with underground facilities, the Customer shall notify One Call and shall have One Call locate all underground facilities before digging. It shall be the responsibility of the Customer to stay clear of all underground facilities.

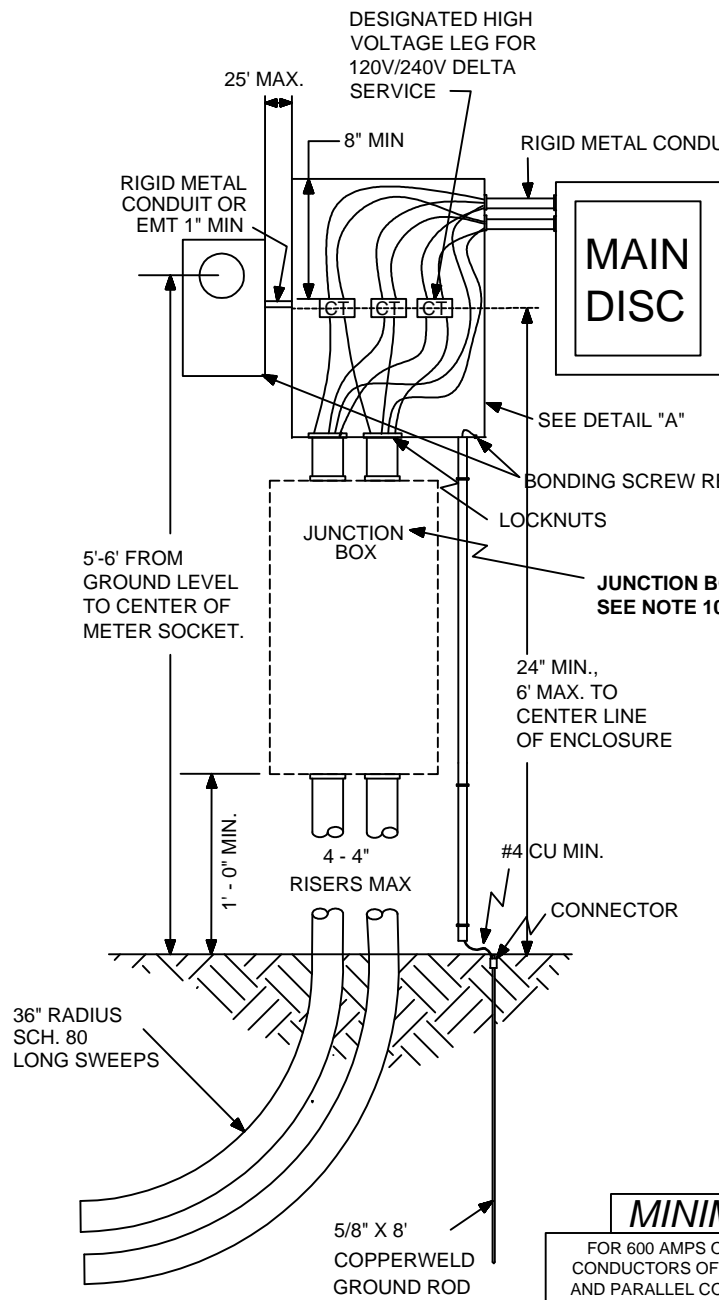

MAIN MAY BE DIRECTLY ABOVE OR ON EITHER SIDE OF CT ENCLOSURE


**Main Disconnect: Readily accessible to Company at all hours with no notice**

**NOTES**

1. All material, except instrument transformers, meter, and meter enclosure are to be furnished, installed, and maintained by the Customer in a location approved by the Company.
2. Instrument transformers and meter enclosure are to be furnished by Company and installed by the Customer.
3. Company reserves the right not to connect service if Company representative considers the installation not safe or not adequate.
4. Service structure shall be as close as possible to the Company pole to which the service is to be connected, not to exceed 150 ft.
5. Use masonry anchors to secure the meter arrangement (plastic anchors are not allowed).
6. Conductor shall be installed in conduit where exposed.
7. PTs, when required, are mounted on side of ct enclosure closest to meter.
8. Single phase 120v/240v 3 wire service requires only 2 CTs.
9. More than two conductors may require larger size enclosures. Consult the Company.
10. When the Customer provides, owns, installs, and maintains the cable to the Company's transformer, a junction box is not required. Consult the Company.
11. See section 8.7.1 for junction box sizing and Customer supplied connectors.

**MINIMUM CT METER ENCLOSURE**

FOR 600 AMPS OR BELOW OR SINGLE CONDUCTORS OF 750 MCM OR GREATER AND PARALLEL CONDUCTORS UP TO AND INCLUDING 500 MCM	14" x 32" x 40" STEEL INSTRUMENT TRANSFORMER ENCLOSURE
FOR 600 - 800 AMPS OR PARALLEL CONDUCTORS GREATER THAN 500 MCM	14" x 32" x 54" STEEL INSTRUMENT TRANSFORMER ENCLOSURE
FOR 800 AMPS OR PARALLEL CONDUCTORS GREATER THAN 750 MCM	CONSULT THE COMPANY

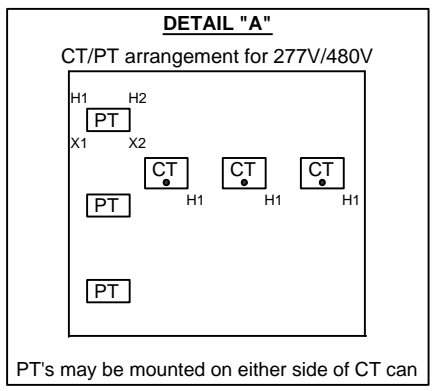

**ENTERGY SERVICES, INC.**

**CURRENT INSTRUMENT TRANSFORMER FOR UNDERGROUND SERVICE**


APPROVED BY: JRH	DATE: 04-23-01
CHECKED BY: JED	SCALE: NONE
DRAWN BY: C HAHN/DAT	CEA NO. 00000

**No. SS11.8-4**


PLOT 1=1 SH. 1 OF 1

3	3/08	UPDATED: CUSTOMER INSTALLATION STANDARDS TEAM	DAT	
2	4/05	UPDATED: CUSTOMER INSTALLATION STANDARDS TEAM	DAT	
1	4/02	UPDATED: CUSTOMER INSTALLATION STANDARDS TEAM	DAT	
NO.	DATE:	REVISION	BY:	APPR:

### UNDERGROUND CLEARANCE FOR SWIMMING POOL

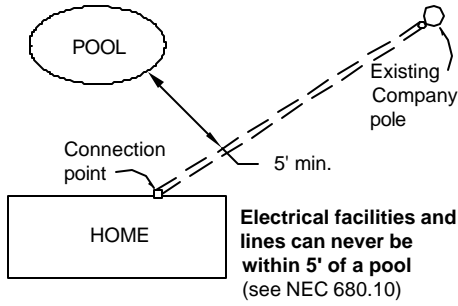


### UNDERGROUND REQUIREMENTS FOR PAVED AREAS

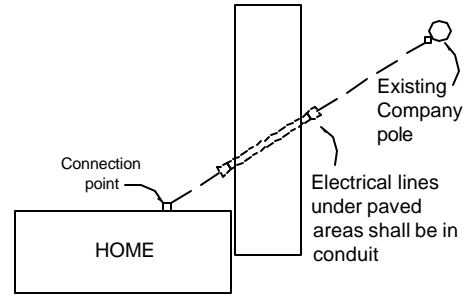


### UNDERGROUND FACILITIES CLEARANCES

From shrubs, trees, buildings, fences, decks etc.

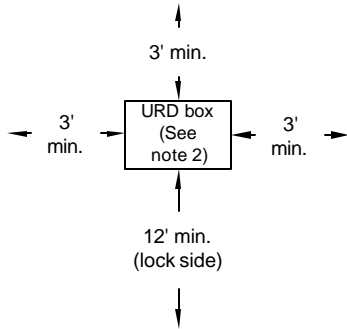


### DO NOT BLOCK ACCESS TO ELECTRICAL FACILITIES

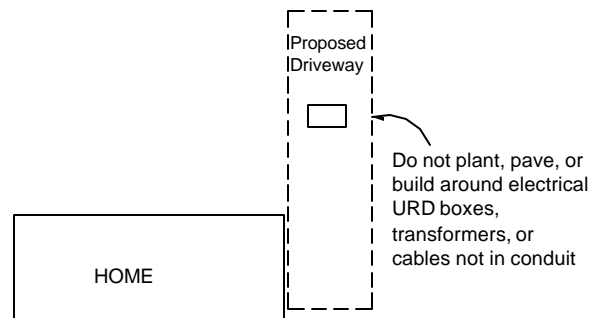

### METER CLEARANCES


HOUSE

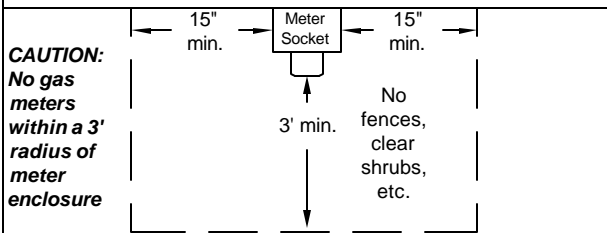

**CAUTION:**  
No gas meters within a 3' radius of meter enclosure

For residential service, the meter is to be located on the outside of the building on the side of the residence within three feet of the front wall and outside of the fences on the side most economical to reach the company's facilities.

Place temporary underground service wire here (underground 30" deep)

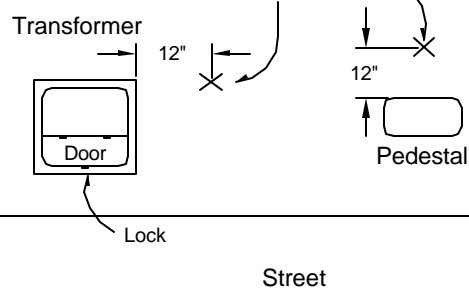

### Call 48 Hours Before You Dig 1-888-258-0808

In locations with underground facilities, the Customer shall notify One Call and shall have One Call locate all underground facilities before digging. It shall be the responsibility of the Customer to stay clear of all underground facilities.

Notes:

1. The customer is responsible for clearing and maintaining all right of way.
2. Transformers must meet requirements of drawing SS10.1-1

2	3/08	UPDATED: CUSTOMER INSTALLATION STANDARDS TEAM	DAT	
1	2/05	UPDATED: CUSTOMER INSTALLATION STANDARDS TEAM	DAT	
NO.	DATE:	REVISION	BY:	APPR:

ENTERGY SERVICES, INC.



### Underground Service Installation Details & Clearances

APPROVED BY:	JRH	DATE:	April 2002
CHECKED BY:	LKE	SCALE:	None
DRAWN BY:	DAT		







No. SS8.6-6

PLOT 1=1 SH. 1 OF 1

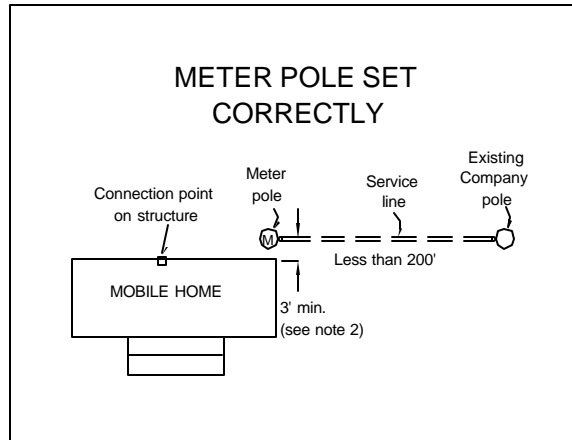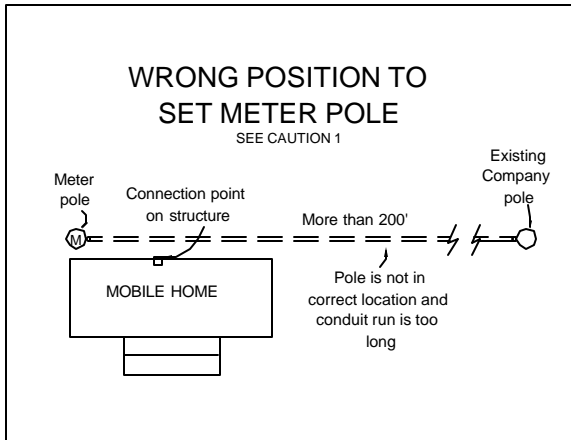

**CAUTION 1:** Maximum length is 200'. For longer lengths contact the company (see note 3). This may involve additional costs to the customer.

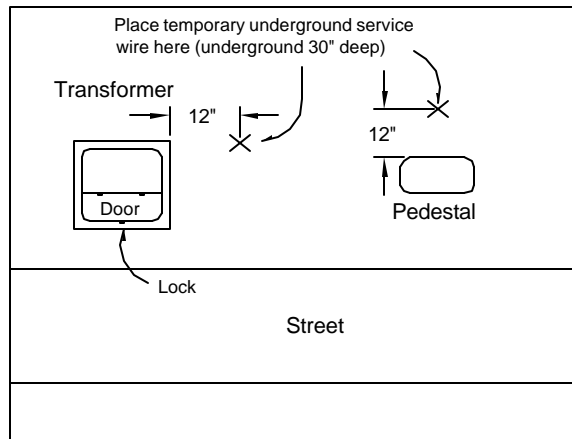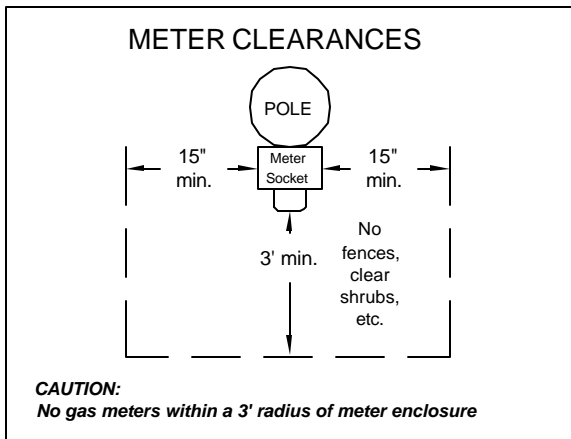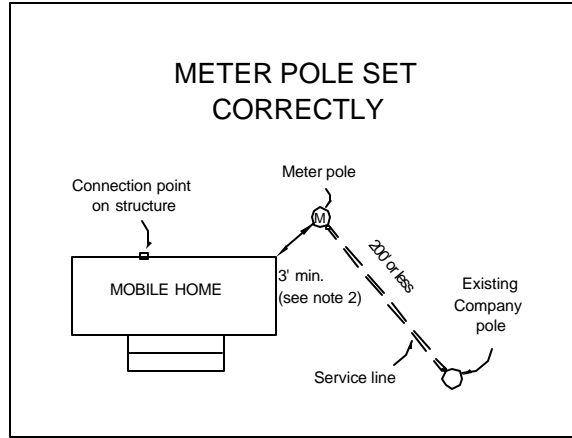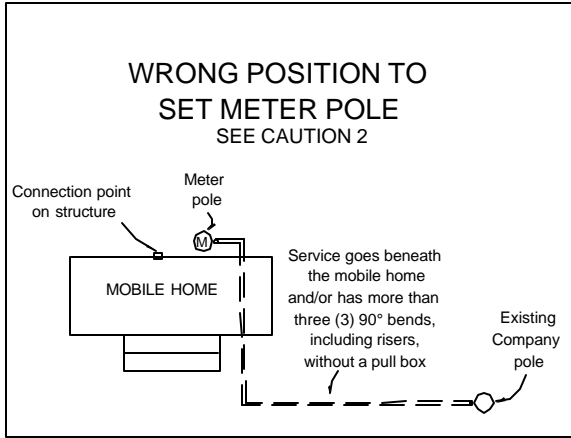

**CAUTION 2:** For a conduit installation having more than three (3) 90° bends, including bends in conduit on meter pole and utility pole, an approved pull box may be required (see note 3). This may involve additional cost to the customer. Company owned or maintained underground service shall not be installed beneath a mobile home or any other structure (see note 4).

**Notes:**

1. Customer facilities shall comply with Company Standards, the National Electrical Code, and authorities having jurisdiction.
2. Meter pole shall be more than 3' from the mobile home (see drawing SS8.6-6 Meter Clearances).
3. It is recommended that the customer contact the company prior to the installation of the conduit system.
4. Company owned or maintained underground service shall **not** be installed beneath a mobile home or any other structure.
5. The customer is responsible for clearing and maintaining all right of way.

**Call 48 Hours Before You Dig**  
**1-888-258-0808**

In locations with underground facilities, the Customer shall notify One Call and shall have One Call locate all underground facilities before digging. It shall be the responsibility of the Customer to stay clear of all underground facilities.

<b>ENTERGY SERVICES, INC.</b>			
<b>Underground Service Details for Single Mobile Home Installation</b>			
APPROVED BY:	JRH	DATE:	March 2002
CHECKED BY:	LKE	SCALE:	None
DRAWN BY:	DAT		
<b>Entergy</b>		<b>No. SS4.6-4</b>	
PLOT	1=1	SH.	1 OF 1

2	3/08	UPDATED: CUSTOMER INSTALLATION STANDARDS TEAM	DAT	
1	2/05	UPDATED: CUSTOMER INSTALLATION STANDARDS TEAM	DAT	
NO.	DATE:	REVISION	BY:	APPR: